

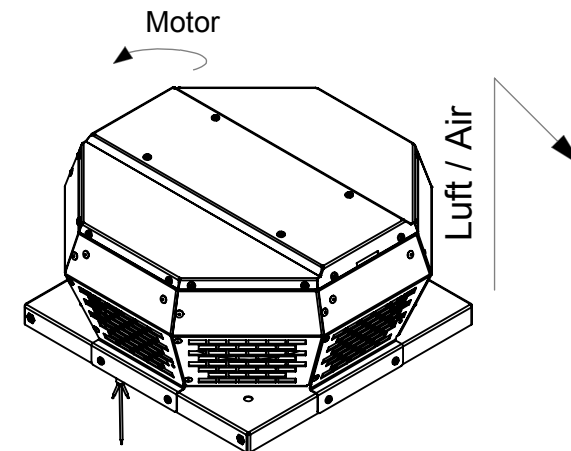
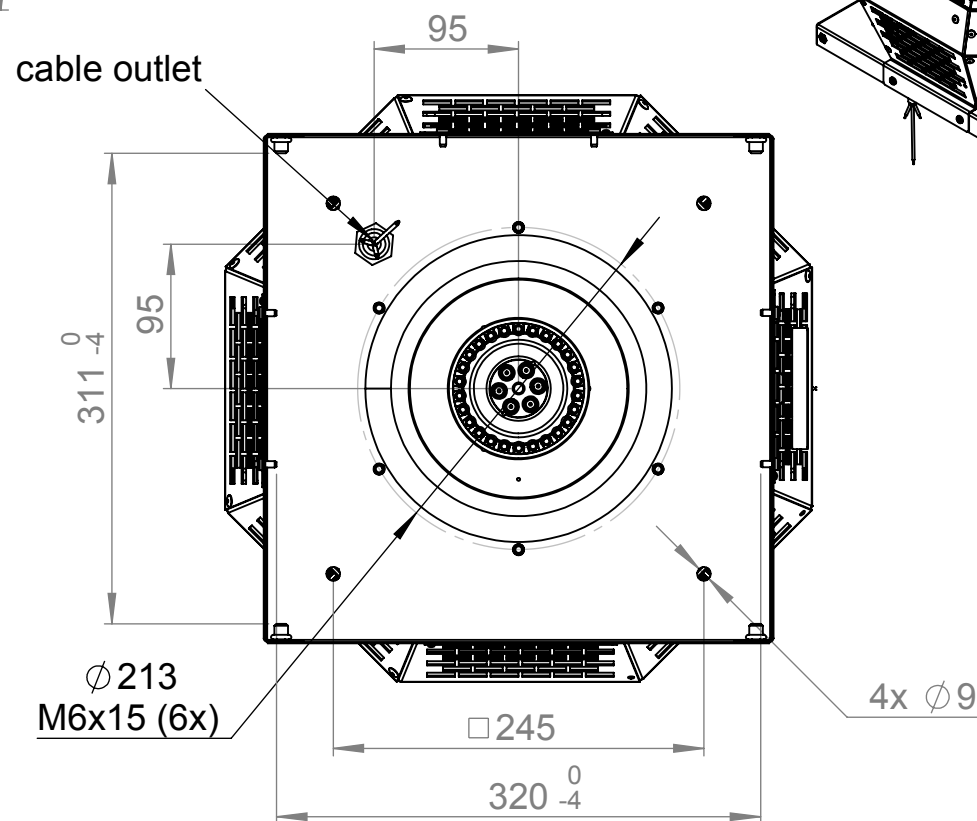


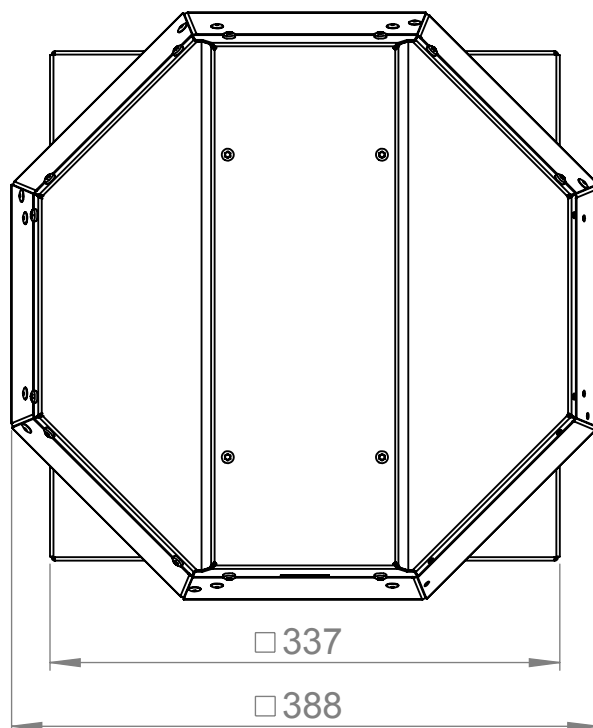

ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

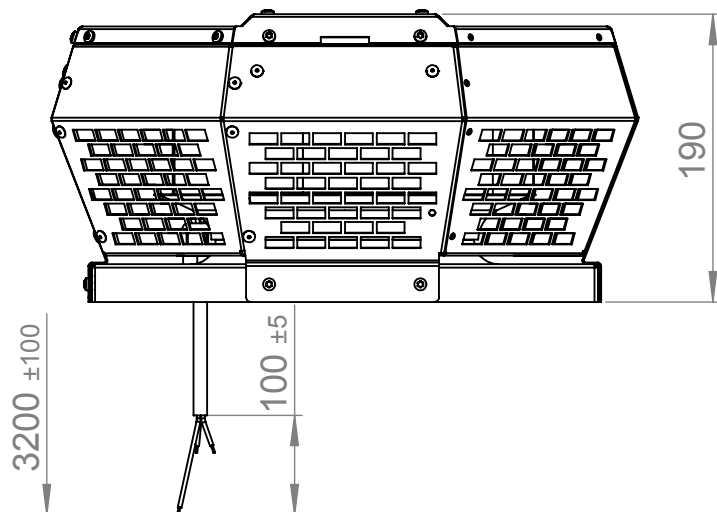

Protection Mark
according to ISO16016

Created d.hancu
Drawn d.hancu
Released v.brand
Disabled

1:5 A4 mm

General tolerances
DIN ISO 2768-c

27.06.2014
27.06.2014
15.07.2019

DHA250E430+

130450 00